


B20691

A-PDF Watermark DEMO: Purchase from www.A-PDF.com to remove the watermark

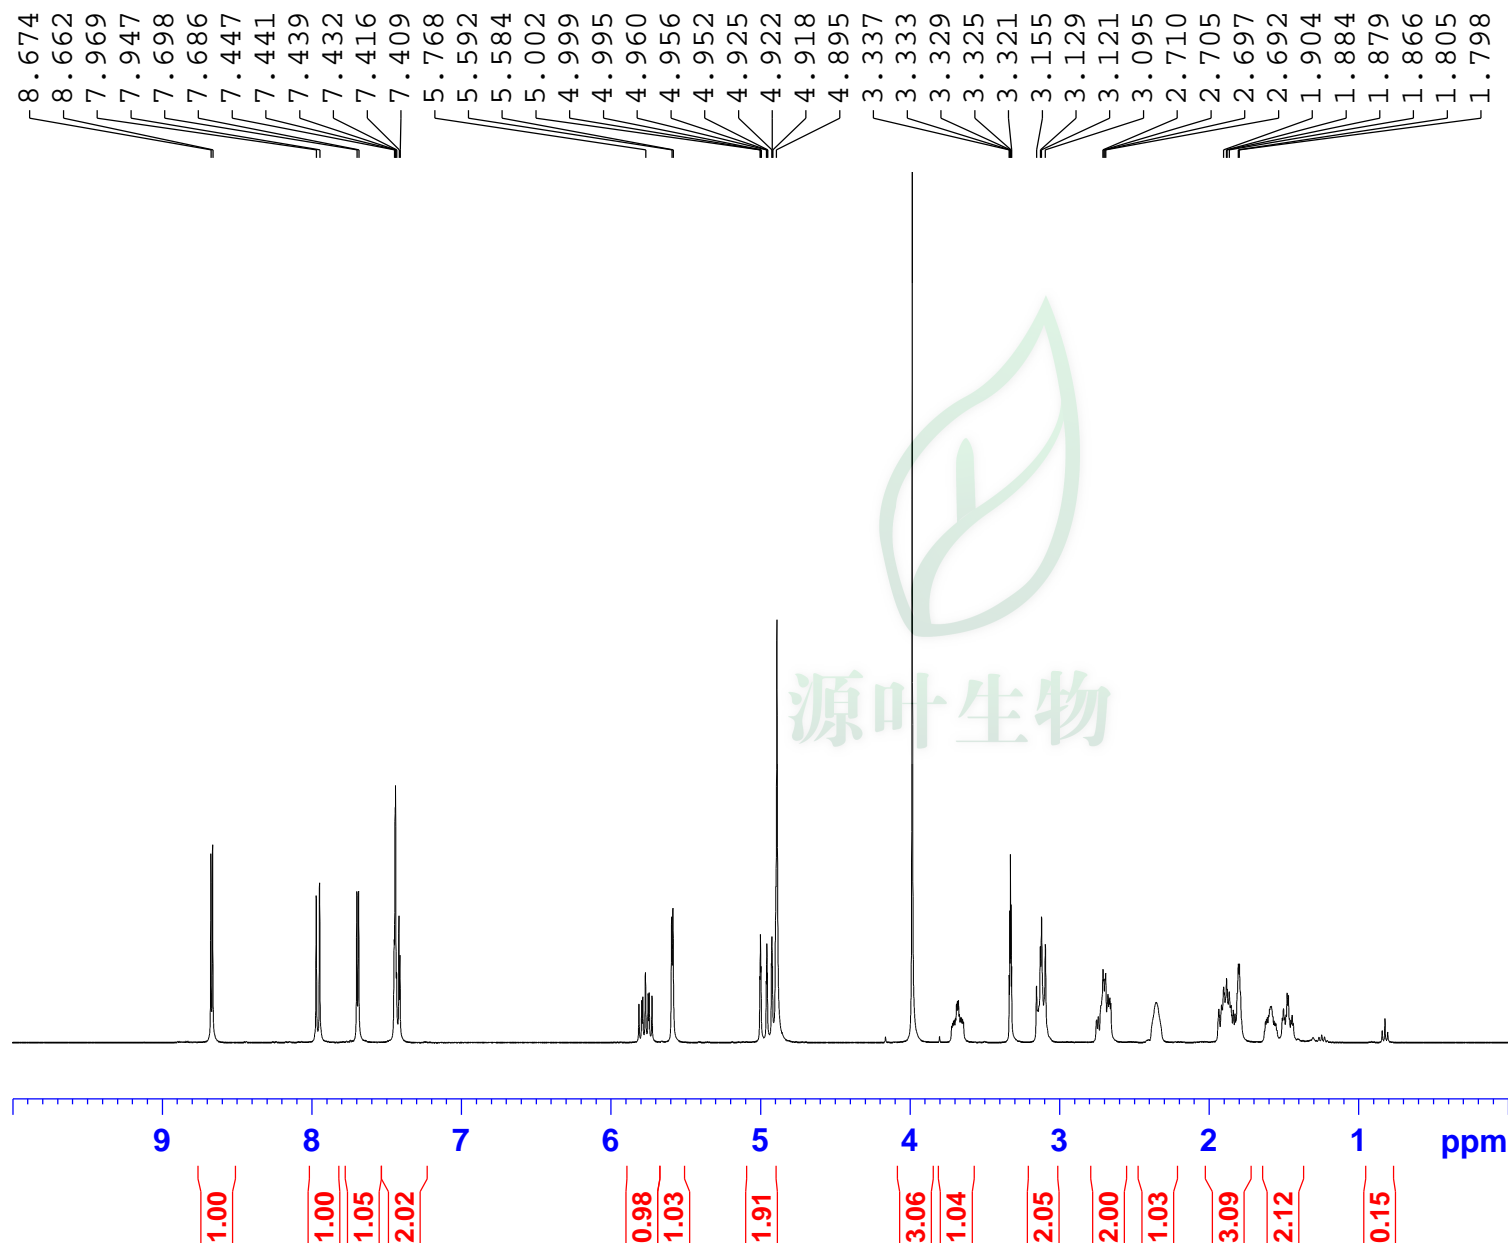

## Current Data Parameters

NAME B20691  
EXPNO 12  
PROCNO 1

## F2 - Acquisition Parameters

Date\_ 20180427  
Time 17.32  
INSTRUM spect  
PROBHD 5 mm PABBO BB-  
PULPROG zg30  
TD 65536  
SOLVENT MeOD  
NS 16  
DS 2  
SWH 8223.685 Hz  
FIDRES 0.125483 Hz  
AQ 3.9846387 sec  
RG 119.54  
DW 60.800 usec  
DE 6.50 usec  
TE 298.1 K  
D1 1.00000000 sec

## ===== CHANNEL f1 =====

NUC1 1H  
P1 12.00 usec  
PLW1 22.00000000 W  
SFO1 400.1324710 MHz

## F2 - Processing parameters

SI 65536  
SF 400.1300000 MHz  
WDW EM  
SSB 0  
LB 0.30 Hz  
GB 0  
PC 1.00